



Antron Electronics Co.,LTD
安雄電子股份有限公司

Constant Current Emergency LED Driver




| | |
|------------------------|--|
| Model Name | EMLEDS20-1555-9.6CHXNB-FT 16W |
| Output Mode | Constant Current |
| Input Voltage | 120-277 Vac |
| Input Frequency | 50/60 Hz |
| Dimming | N/A |
| Surge Rating | 3KV |
| Warranty | 5 Years TC $\leq 60^{\circ}\text{C}$ 3 Years TC $\leq 66^{\circ}\text{C}$ |

Product Specification




| Output Power (W) | Output Voltage (V) | Output Current (mA) | Operating Duration Time | Operating Temp. ($^{\circ}\text{C}$) | Battery Voltage (V) | Battery Charge Current (mA) | Battery Charge Time | Input Power (W) | Input Current (mA) |
|------------------|--------------------|---------------------|-------------------------|--|---------------------|-----------------------------|---------------------|-----------------|--------------------|
| Max. 16 | 15-55 | 290 | Min. 90min | 0-50 | 9.6 | 350 | Min. 24Hrs | Max. 4.6 | Max. 113 |

Wire Diagram

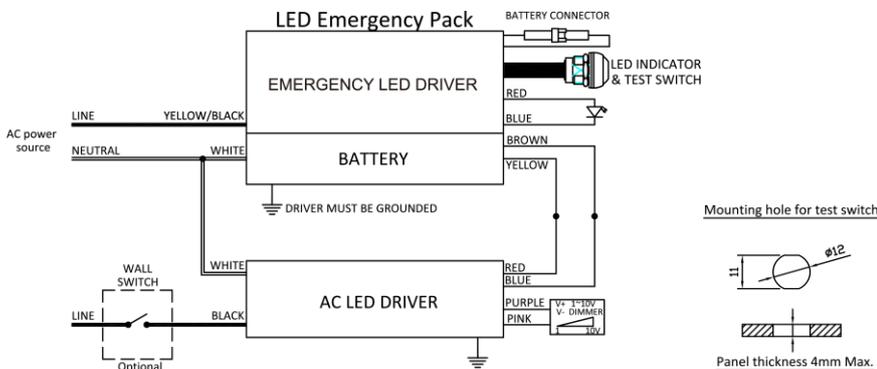

Maximum Wiring Distance (at full load) is 18AWG/18Feet

Enclosure

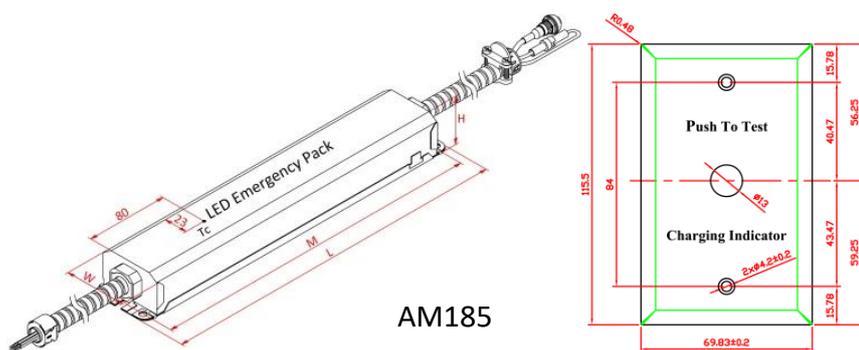

| Enclosure | Inch | Cm |
|-------------|-------|------|
| Length(L) | 13.3 | 33.8 |
| Width(W) | 2.44 | 6.2 |
| Height(H) | 1.49 | 3.8 |
| Mounting(M) | 12.68 | 32.2 |



Input Specifications

| Parameter | Min. | Typ. | Max. | Notes |
|-----------------|------|----------|--------|------------------------------|
| Input Voltage | 108V | 120/277V | 305V | |
| Input Current | - | - | 0.113A | @120Vac input with full load |
| Input Frequency | 47Hz | 60Hz | 63Hz | |
| Leakage Current | - | - | 0.7mA | @277Vac input |
| Turn On Time | - | - | 1.0s | @120Vac input at full load |
| Hold Up Time | - | - | 0.1s | @Nominal input and full load |
| Efficiency | % | % | % | @55Vdc output at full load |
| Standby Power | - | - | 4.6W | |

Output Specifications

| Parameter | Min. | Typ. | Max. | Notes |
|------------------------|-------|-------|-------|------------------------|
| Output Voltage | 15V | - | 55V | |
| Output Current | - | 290mA | - | @55Vdc-@15Vdc |
| Battery Charge Current | | 350mA | | LiFePO4, 9.6V, 3600mAh |
| Battery Voltage | | 9.6V | | |
| Battery Charge Time | | | 24Hrs | |
| Emergency Operation | 90min | | | |
| No-Load Output Voltage | 55V | 58V | 60V | |
| Rated Current | 276mA | 290mA | 305mA | |
| Rated Power | - | 16W | - | |
| Output Current Ripple | - | ±10% | - | |

General Specifications

| Parameter | Min. | Typ. | Max. | Notes |
|---------------|-----------------|------------------|------|--|
| MTBF | - | 100,000 Hours | - | @25°C ambient temperature |
| Lifespan Time | 75,000 Hours | - | - | In the range of specification required by normal use of the power supply at ambient temperature 55°C |
| Cold Start | - | - | 2.0s | @0°C |



Test Switch

Test Switch Operation

With AC power source alive

1. Push and Hold for 2 seconds, the unit will transfer from charge mode to discharge mode, the indicator is OFF.
2. Release the test switch, the unit will back to charge mode automatically, the indicator is ON.

Protection

| Parameter | Description |
|------------------|---|
| Over Voltage | Output current decay mode, recovers automatically after fault condition is removed. |
| Short Circuit | Hiccup mode, recovers automatically after fault condition is removed. |
| Over Temperature | Shut down o/p voltage, re-power on to recover. |

Environmental Specifications

| Parameter | Min. | Typ. | Max. | Notes |
|-----------------------|-------|------|------|-------|
| Operation Temperature | 0°C | - | 50°C | |
| Storage Temperature | -20°C | - | 55°C | |
| Humidity | 10% | - | 90% | |
| T-Case Temperature | - | - | 66°C | |

Safety and EMC Compliance

| Safety Standards | Withstand Voltage | Isolation Resistance | EMC Standards | |
|--------------------------------|---|--|---------------------|---------------------|
| | | | EMI | EMS |
| UL 924 CSA C22.2 No. 141-15 | I/P-O/P: 2.0K Vac I/P-FG: 2.0K Vac O/P-FG: 0.5K Vac | I/P-O/P: I/P-FG: O/P-FG: 100Mohm/500VDC | FCC Part 15 class A | FCC Part 15 class A |

Note

- The emergency backup driver shall be installed inside an electrical enclosure. If the application requires the emergency pack to be mounted on top of the luminaire please use Model which provides a metal flexible conduit instead of bare wires.

